
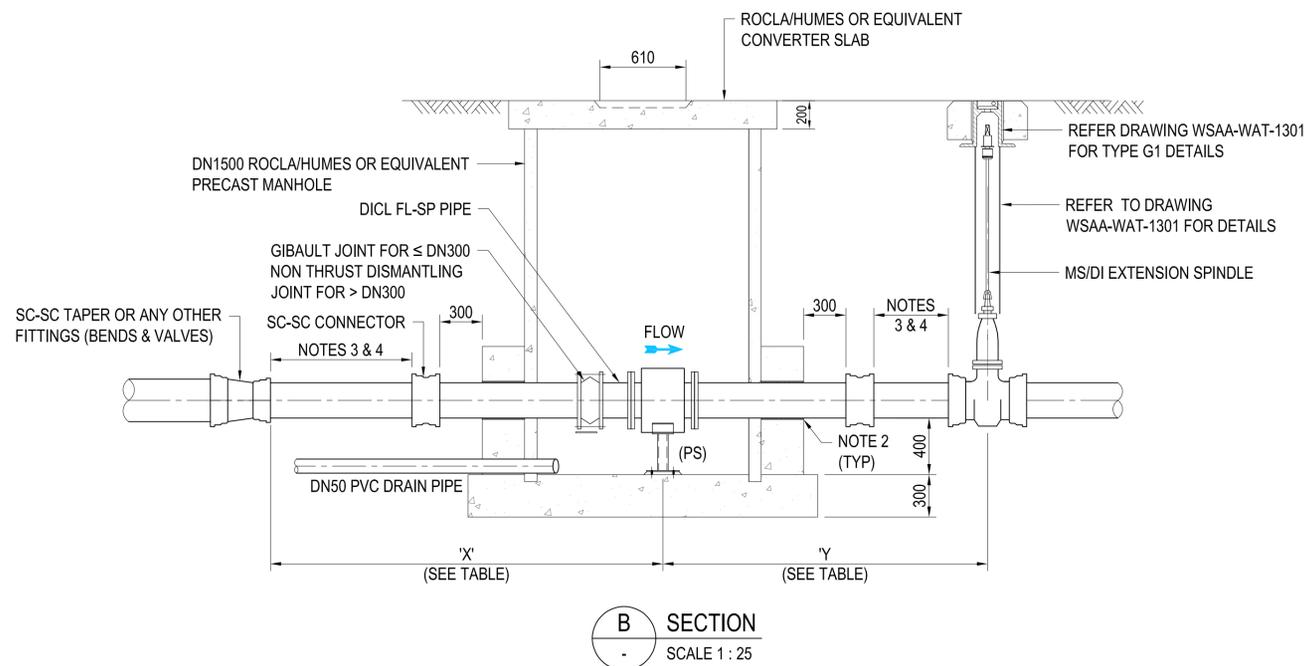
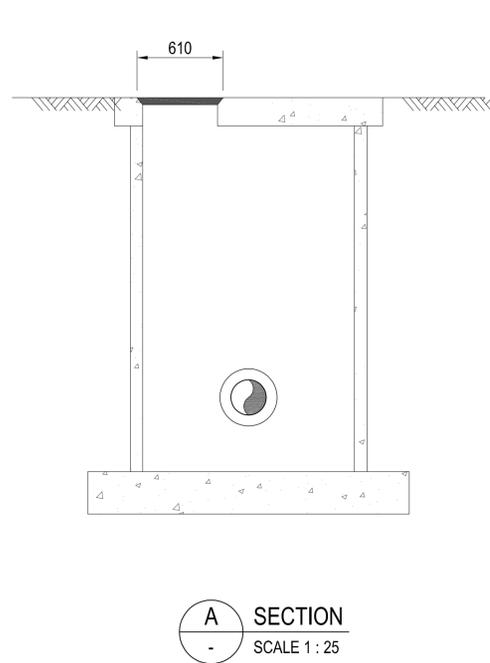
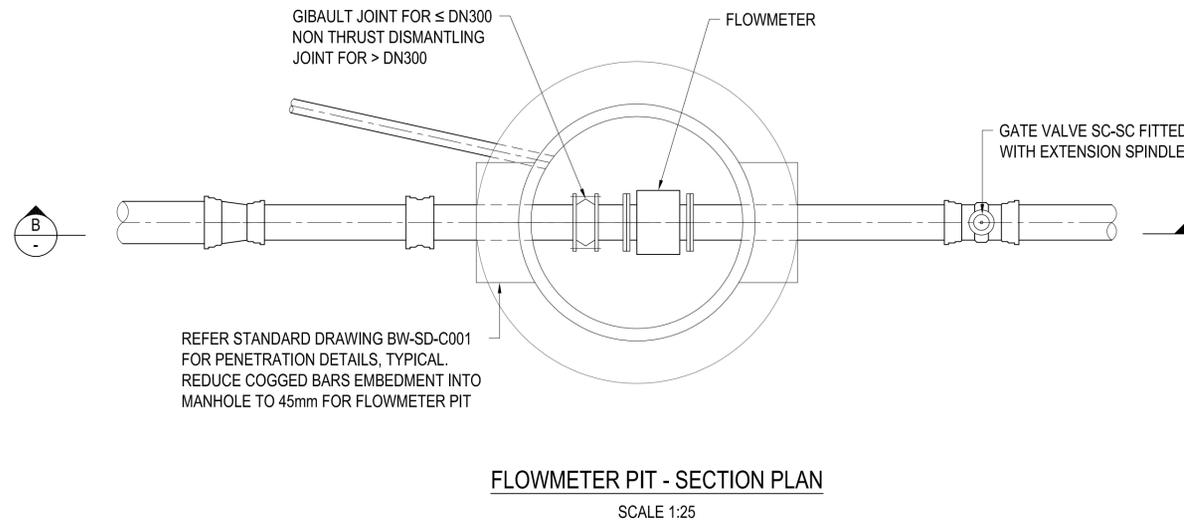


DO NOT SCALE

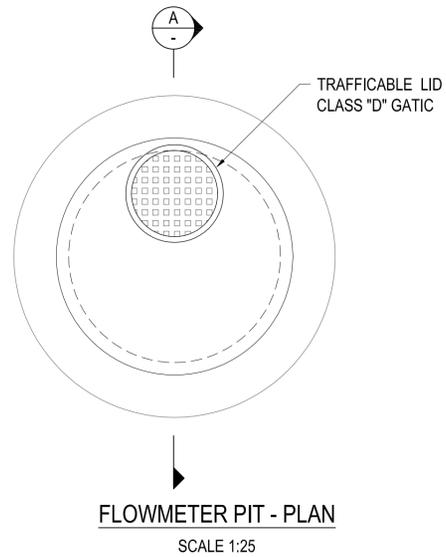

FLOW METER CLEARANCES		
	'X' (UPSTREAM)	'Y' (DOWNSTREAM)
PREFERRED	10d	5d
MINIMUM	5d	AS PER MANUFACTURER'S REQUIREMENTS

d - DENOTES PIPE DIAMETER

NOTES:

- PS - STEEL PIPE SUPPORT REFER TO BW STANDARD DRAWING BW-SD-C0103 FOR DETAILS.
- FOR WELDED MSCL APPLY 10mm ABLEFLEX AROUND PIPE WITH 10mm x 10mm MASTIC SEAL EACH FACE
- RRJ DI, GRP OR MSCL 1500mm MAX ROCKER PIPE.
- RRJ PVC 600mm ROCKER PIPE.

STANDARD DRAWING



DRG No. **BW-SD-W004** DRAWING DISCIPLINE: WATER
SHEET NO. 1 of 1

**BARWON WATER - STANDARD DRAWING
FLOWMETER PIT
LAYOUT AND DETAILS**

DRAWN R.MARRIOTT 15.02.11	DESIGNED M.WOODS 15.02.11	APPROVED P.THOMAS* 11.09.14	SCALES: PLAN SECTION HORIZ. VERT. Scale for A1 sheet
DRAFTING CHECK L.BERON* 12.05.14	DESIGN CHECK G.BERRYMAN* 12.05.14		1:25 1:25 1:25 A1

REFERENCES		REVISIONS							
DRAWING	TITLE	No.	REVISION DESCRIPTION	OPS	OPS DATE	DRAWN	CHECKED	APPROVED	DATE
		0	ISSUED FOR USE (FROM BWA-SD-W004)	-	-	-	-	PT*	11.09.14